



20mm MULTIPLE SERVICES
DETAIL AT PROPERTY LINE

Note: Polyethylene pipe shall be HDPE blue line PN16

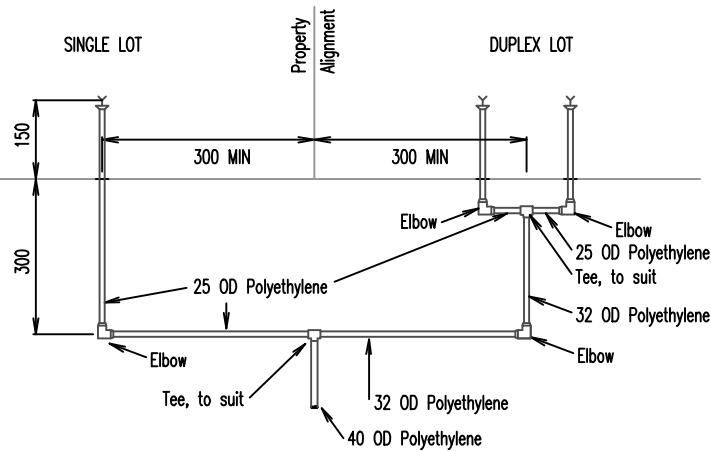

25mm DUPLEX & MULTIPLE SERVICES
DETAIL AT PROPERTY LINE (ALTERNATIVE 1)

Note: Polyethylene pipe shall be HDPE blue line PN16

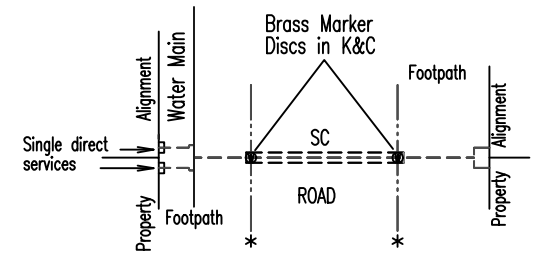


SERVICES LAYOUT

LEGEND

- * NOM. kerb line
- SC Service conduit. 100mm Class 9 uPVC


NOTES:

1. Underground Meter Box on approval only.
2. The section of main at the proposed tapping point must be first cleaned and wrapped with a minimum of two layers of self-adhesive polyvinylchloride wrapping.
3. A 20mm meter is to be installed on all services, unless otherwise specified on the project drawings.
4. All pipes & fittings as per WRC STD DWG W-0090
5. Single 20mm service road crossing refer to WRC STD DWG W-0042.
6. All dimensions in millimetres.
7. All services must cross the road at right angles.
8. Ferrule stop cock access tube and cap must not have any barring pressure on the ferrule cock and pipe leading away.
9. Where water mains are situated in a roadway, a cast iron trafficable box must be provided at each ferrule cock/tapping band.

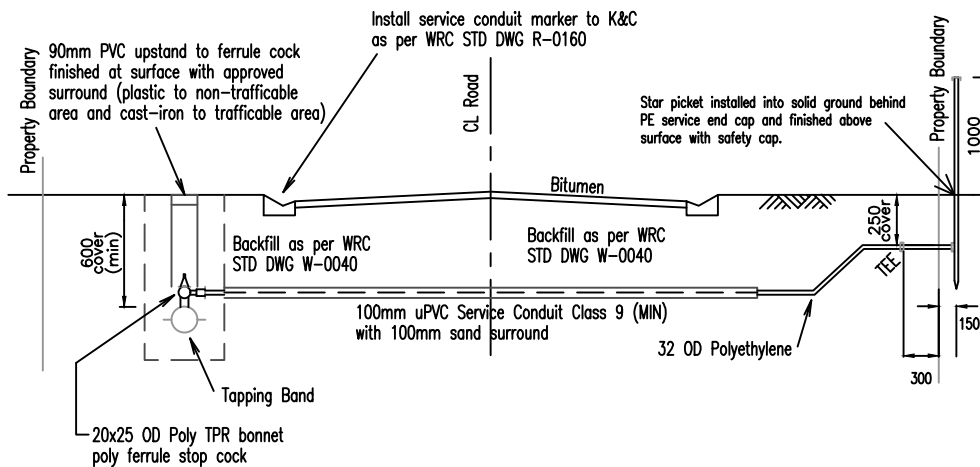

TYPICAL SECTION

MULTIPLE 20 ϕ -63 ϕ SERVICE ROAD CROSSING WITH MAIN UNDER FOOTPATH

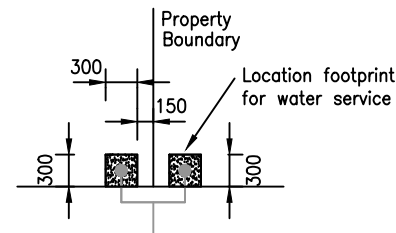

TYPICAL SERVICE
INSTALLATION SETUP

F	DEVELOPMENT MANUAL UPDATES AND AMENDMENTS 2018	26/10/18
E	GENERAL UPDATES AND AMENDMENTS	26/9/18
D	GENERAL UPDATES AND STANDARD REFERENCING AMENDMENTS	27/4/16
C	GENERAL UPDATES	9/4/12
B	DUPLEX SERVICES ADDED	15/5/09
A	ORIGINAL ISSUE	11/7/07
REVISIONS		DATE



Email: info@whitsundayrc.qld.gov.au Web: www.whitsundayrc.qld.gov.au

BOWEN
67 Herbert St
Bowen 4805 Q
Ph 07 4761 3600

COLLINSVILLE
Cnr Stanley & Conway Sts
Collinsville 4804 Q
Ph 07 4785 5366

PROSERPINE
83-85 Main St
Proserpine 4800 Q
Ph 07 4945 0200

WATER SERVICE ARRANGEMENT
SINGLE AND DOUBLE
(ABOVE GROUND METER)

WATER
Standard
Drawing
W-0092

B C D E F